

TELEPHONE (AREA CODE 214)
565-0593
565-0594
421-1400

THE ASSOCIATED LABORATORIES
OPERATING

CABLE ADDRESS "DALAB"

THE DALLAS LABORATORIES

MEMBERS
ASSOCIATION OF CONSULTING CHEMISTS AND
CHEMICAL ENGINEERS
AMERICAN INSTITUTE OF CHEMICAL ENGINEERS
AMERICAN INSTITUTE OF MINING,
METALLURGICAL AND PETROLEUM
ENGINEERS
AMERICAN SOCIETY OF PROFESSIONAL ENGINEERS
TEXAS SOCIETY OF PROFESSIONAL ENGINEERS
DALLAS PETROLEUM ENGINEERS CLUB
AMERICAN SOCIETY OF HEATING, REFRIGERATION
AND AIR CONDITIONING ENGINEERS

CONSULTANTS AND TECHNOLOGISTS
ANALYTICAL AND RESEARCH CHEMISTS -
CHEMICAL ENGINEERS - PETROLEUM ENGINEERS -
QUALITY CONTROL ENGINEERS - CONSUMER
CERTIFICATION PROGRAMS - BACTERIOLOGISTS -
SANITARY INSPECTIONS - FORMULATION - LABELLING

P. O. BOX 15705
1323 WALL ST.

DALLAS, TEXAS 75215

MEMBERS
AMERICAN CHEMICAL SOCIETY
AMERICAN SOCIETY FOR TESTING MATERIAL
AMERICAN ASSOCIATION OF CEREAL CHEMISTS
FELLOW, AMERICAN INSTITUTE OF CHEMISTS
AMERICAN WATER WORKS ASSOCIATION
AMERICAN PUBLIC HEALTH ASSOCIATION
AMERICAN NATIONAL STANDARDS INSTITUTE
AMERICAN SOCIETY FOR QUALITY CONTROL

Submitted by: Alumax
Building Specialties Division
P. O. Box 163
227 Town East Boulevard
Mesquite, TX 75149

Date August 20, 1987

Attn: Mr. Yoosef Lavi
P. E.

Report No. 11890

REPORT

~~Sample~~

SUBJECT: Performance testing of one Roof Deck Assembly "SLIM-SEAM" in accordance with ASTM E 283-84 (Air Infiltration), and ASTM E 331-86 (Water Resistance).

Summary of Test Results

<u>Title of Test</u>	<u>Results</u>
Air Infiltration @ 1.57 psf	0.09 CFM/Ft ²
Air Infiltration @ 6.24 psf	0.21 CFM/Ft ²
Water Resistance @ 6.24 psf	No Leakage
Water Resistance @ 10.00 psf	No Leakage
Water Resistance @ 25.00 psf	No Leakage

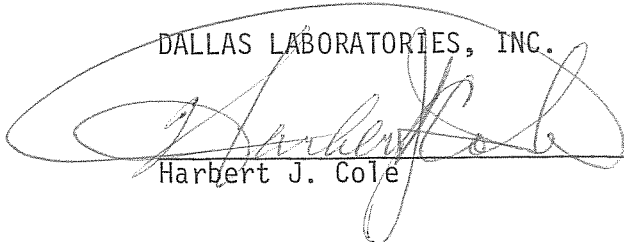
The above results were obtained by using the applicable ASTM test methods.

*

*

*

DALLAS LABORATORIES, INC.


Herbert J. Cole

HJC:td